

STEAM:


Set Sum of Pressures At Pressure Differential.
Read Capacity in Lb/Hr At Valve Coefficient.
Check Capacity at Critical Drop. Use The Lower Capacity.

STEAM (CRITICAL DROP):

Set Inlet Pressure In Window. Locate Desired Capacity (Lbs/Hr). Read Valve Coefficient (Cv) Directly Opposite.

WATER:

Set Pressure Differential At Arrow. Locate Desired Capacity (G.P.M.). Read Valve Coefficient (Cv) Directly Opposite.

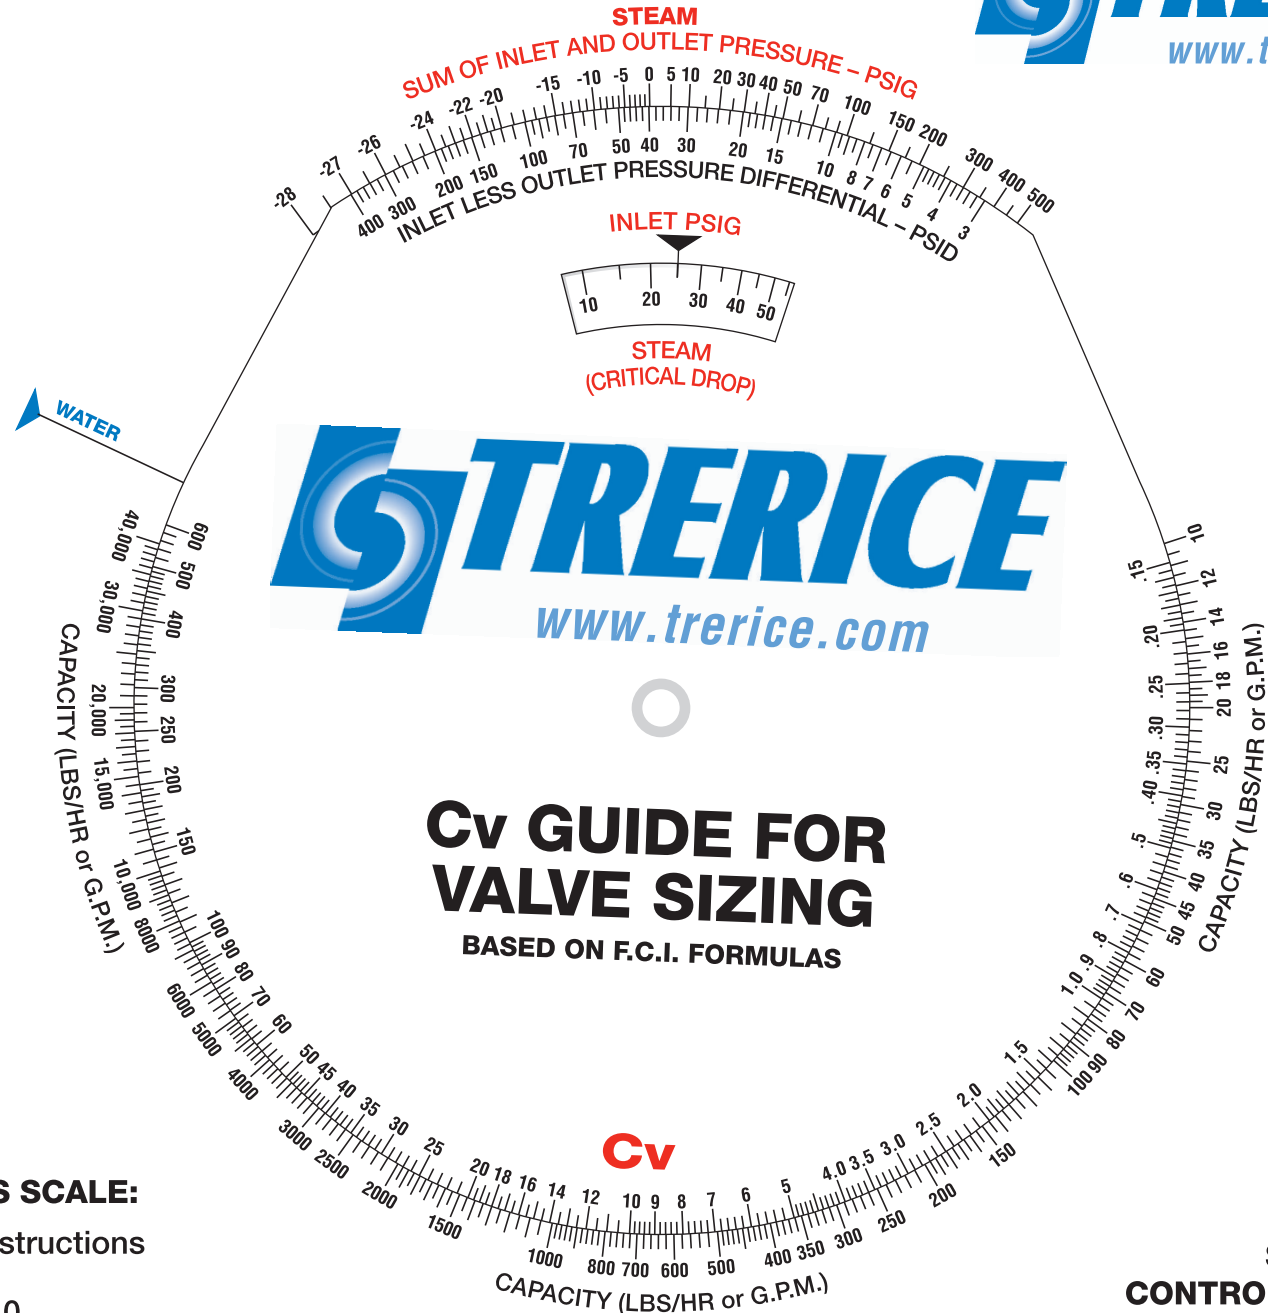

FOR CAPACITIES BEYOND THIS SCALE:

- A) Set Pressure According to Instructions Above.
- B) Divide Desired Capacity by 10.
- C) Read Apparent Cv.
- D) Multiply Apparent Cv by 10.

**SEE
CONTROLS CATALOG
FOR VALVE AND ACTUATOR
SELECTION.**